

**COUNTY OF IMPERIAL**

**GATEWAY COUNTY SERVICE AREA  
WATER TREATMENT PLANT IMPROVEMENTS**

**SEPTEMBER 3, 2024**

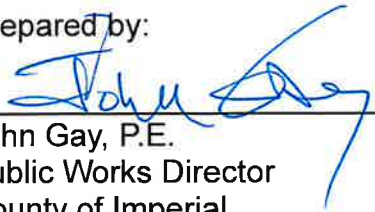
**ADDENDUM NO. 4**

The bidders are advised that the Contract Documents, Specifications, and Plans for the Gateway County Service Area Water Treatment Plant Improvements project are hereby amended per the statements in this Addendum.

1. The trailer mounted temporary generator set call out note on plan sheet 13 is directed at a 35 KW generator set for the "short term temporary bypass pumping system" and a 75 KW generator set for the "long duration temporary bypass pumping system." Similarly, long term temporary bypass keynote 5 on plan sheet 13 states, *"It is estimated that the smaller trailer mounted generator set will be sized at approximately 35 KW, 277/480 Volt, 3 phase, 4 wire and the larger generator set will be sized at approximately 75 KW, 277/480 Volt, 3 phase, 4 wire"*.

The sizing of the short term and long term generator sets as illustrated by the call out note and long term temporary bypass keynote 5 on plan sheet 13 is to be disregarded. The smaller trailer mounted generator set for the short term temporary bypass pumping system shall be sized at 100 KW, 277/480 volt, 3 phase, 4 wire and the larger trailer mounted generator set for the long term temporary bypass pumping system shall be sized at 200 KW, 277/480 volt, 3 phase, 4 wire.

Prepared by:

  
\_\_\_\_\_  
John Gay, P.E.  
Public Works Director  
County of Imperial

Date: September 3, 2024

**Addendum No. 04 Acknowledgement** \_\_\_\_\_

The Bidder is responsible for advising any and all subcontractors and suppliers of this addendum. Each bidder must acknowledge receipt of this addendum in the noted space below and where indicated in the Bid Form. This sheet of the addendum is to be signed by the Bidder and submitted with the Bid.

Print or Type Bidder's Name: \_\_\_\_\_

Print or Type Authorized Name: \_\_\_\_\_

Authorized Signature of Bidder: \_\_\_\_\_

Date Signed: \_\_\_\_\_